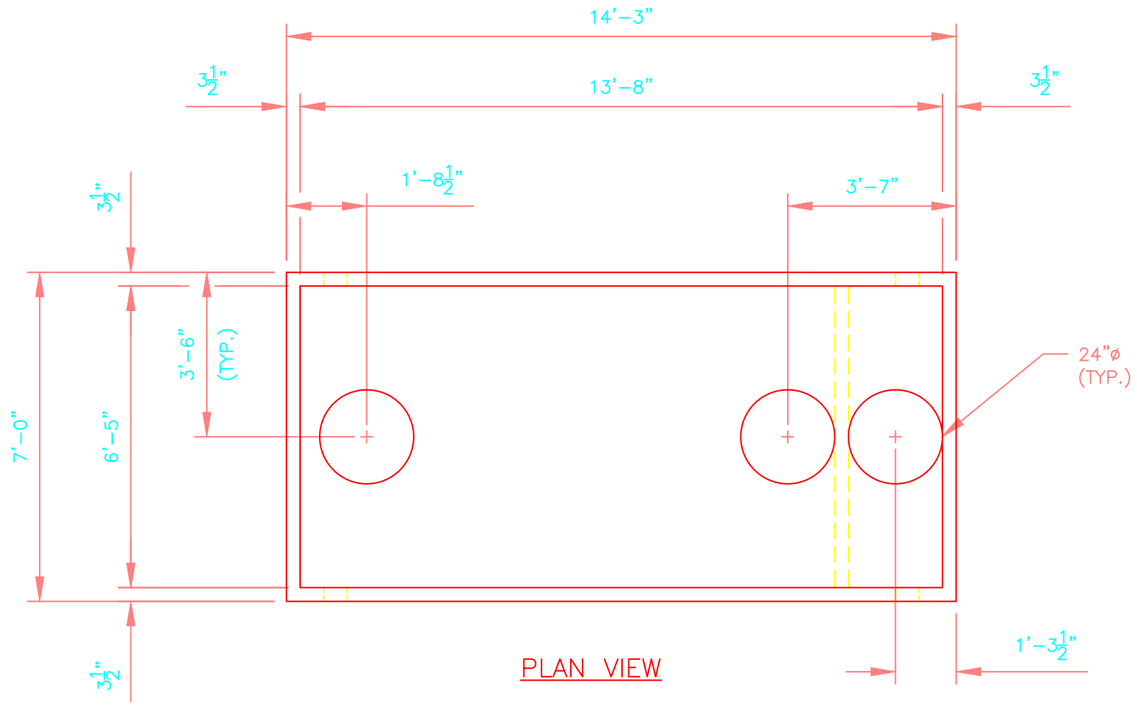

PLAN VIEW

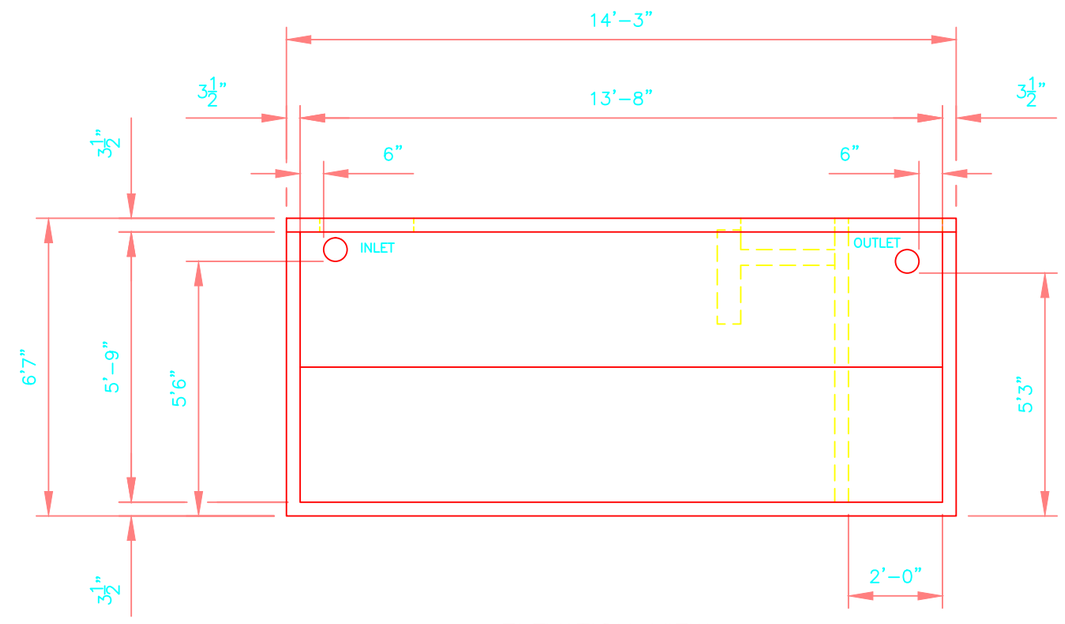

ELEVATION VIEW

NOTES:
1. CONCRETE: 5,000PSI MIN AFTER 28 DAYS.
2. ALL REINFORCEMENT PER ASTM C1227-93.
3. TEES AND GAS BAFFLE SOLD SEPARATELY.
4. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.
5. 4" POLYLOK IV CLOSED END BOOTS USED FOR CONNECTIONS.
6. PLASTIC RISER CAN BE POURED INTO COVER.
7. PUMPS & ACCESSORIES OPTIONAL

REV.NO.	DATE	REVISION

PREPARED FOR:

ANDREW J. FOSS CO. INC.
100 COCHECO ROAD
FARMINGTON, NH 03835
PHONE(603)755-2515 FAX(603)278-7878

PREPARED BY:
DELTA
ENGINEERS, ARCHITECTS, & LAND SURVEYORS
184 COURT STREET, BINGHAMTON, NY 13901
TEL: (607) 231-6600 FAX: (607) 231-6650

DATE: 9/16/09	SHEET TITLE: SKETCH	DRWN BY:	GJP
SCALE: N.T.S.		CKD BY:	KMK

PROJECT:
2639 GALLON TANK
464 GALLON CHAMBER
H-10

CONTRACTOR:		DWG. I.D.	SK-01
DELTA PROJ. NO.:	2009.367.001	SHT. NO.	1 OF 1