




SINGLE PHASE SECTOR CABINET FOUNDATION DETAIL

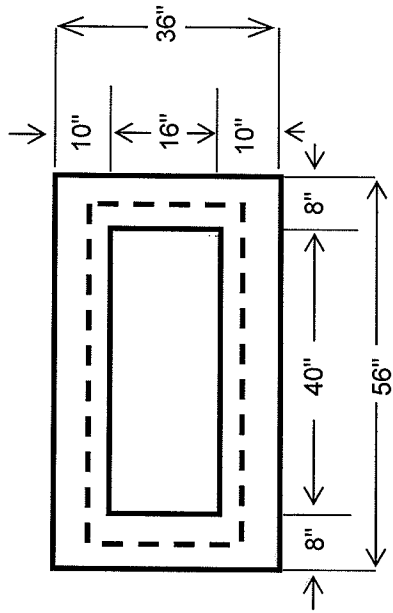


See note 3

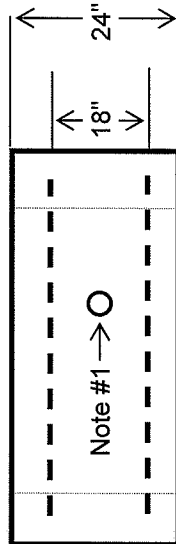

THREE PHASE SECTOR CABINET FOUNDATION DETAIL

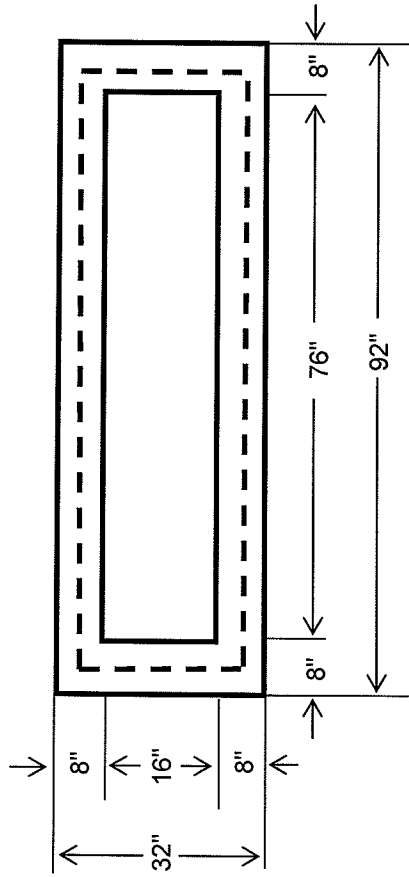

See note 3

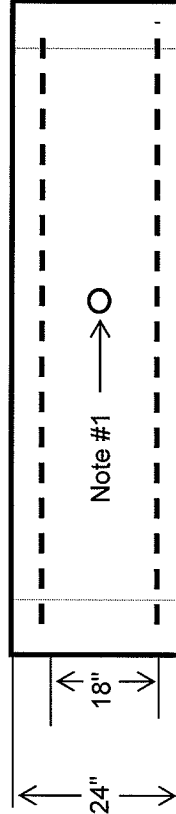

- Notes:
1. 1" PVC conduit sleeve through foundation for grounding leads
 2. All rebar to be #5
 3. Top of foundation should be exposed 3 to 6 inches above ground level.
 4. Concrete shall have a minimum compression strength of 3500 PSI
 5. All reinforcing shall be tied as one unit.
 6. Chamfer all exposed concrete edges 1 inch
 7. Remove all organic material under foundation
 8. Minimum of 3 inches of concrete over reinforcing steel



Public Service
of New Hampshire

CONSTRUCTION REQUIREMENT

ISSUE	DATE
Original	5/9/94
Rev.	10/27/00